



**Environmental
Microbiology
Laboratory, Inc.**


Report for:

Mr. Steve Wallstrom
ENVIRONIX
20728 56th Ave W
Lynnwood, WA 98036


Regarding: Project: Sample report
EML ID: 123456


Date of Analysis: 02-09-2007

Approved by:


Ann Atkinson
Northeast Lab Manager


Dr. Kamashwaran Ramanathan
Northwest Lab Manager


Baluswamy Krishnan
Southeast Lab Manager


Magzoub Ismail
Southwest Lab Manager

Project SOPs: Premium spore trap supplement (100185), Spore trap analysis (100005)

This coversheet is included with your report in order to comply with AIHA and ISO accreditation requirements.

For clarity, we report the number of significant digits as calculated; but, due to the nature of this type of biological data, the number of significant digits that is used for interpretation should generally be one or two. All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank corrections of results is not a standard practice. The results relate only to the items tested.

Environmental Microbiology Laboratory, Inc. ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Document Number: 200091 - Revision Number: 5

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

SPORE TRAP REPORT: NON-VIABLE METHODOLOGY

Location:	1: Outside control		2: West Dehu		3: South bed		4: South entry		5: North	
Comments (see below)	None		None		None		None		None	
Lab ID-Version‡:	1234567-1		1234567-1		1234567-1		1234567-1		1234567-1	
	raw ct.	spores/m3	raw ct.	spores/m3	raw ct.	spores/m3	raw ct.	spores/m3	raw ct.	spores/m3
Alternaria										
Arthrinium										
Ascospores*	20	267	4	53	4	53				
Aureobasidium										
Basidiospores*	104	1,390	12	160	20	267	22	293	22	293
Bipolaris/Drechslera group										
Botrytis										
Chaetomium										
Cladosporium	116	1,550	24	320	28	373			22	293
Curvularia										
Epicoccum										
Fusarium										
Myrothecium										
Nigrospora										
Other brown					6	80	1	13		
Other colorless										
Penicillium/Aspergillus types†	16	213	28	373	72	960			44	587
Pithomyces										
Rusts*										
Smuts*, Periconia, Myxomycetes*										
Stachybotrys										
Stemphylium										
Torula										
Ulocladium										
Unknown										
Zygomycetes										
Background debris (1-4+)††	2+		4+		4+		4+		4+	
Sample volume (liters)	75		75		75		75		75	
TOTAL SPORES/M3		3,420		906		1,733		306		1,173

Comments:

* Most of these spore types are not seen with culturable methods (Andersen sampling), although some may appear as non-sporulating fungi. Most of the basidiospores are "mushroom" spores while the rusts and smuts are plant pathogens.

† The spores of *Aspergillus* and *Penicillium* (and others such as *Acremonium*, *Paecilomyces*) are small and round with very few distinguishing characteristics. They cannot be differentiated by non-viable sampling methods. Also, some species with very small spores are easily missed, and may be undercounted.

†† Background debris indicates the amount of non-biological particulate matter present on the trace (dust in the air) and the resulting visibility for the analyst. It is rated from 1+ (low) to 4+ (high). Counts from areas with 4+ background debris should be regarded as minimal counts and may be actually higher than reported. Background debris also affects the reporting limit for some spore types. The reporting limit is dependent on spore size, background debris, sample volume, and the percentage of the trace analyzed. It is important to account for sample volumes when evaluating dust levels. The minimum reporting limit is based on a raw count of one, which the lowest count that can be detected.

‡ A "Version" greater than 1 indicates amended data.

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

SPORE TRAP REPORT: NON-VIABLE METHODOLOGY

Location:	1: Outside control		2: West Dehu		3: South bed		4: South entry		5: North	
Comments (see below)	None		None		None		None		None	
Lab ID-Version‡:	1234567-1		1234567-1		1234567-1		1234567-1		1234567-1	
	raw ct.	spores/m3	raw ct.	spores/m3	raw ct.	spores/m3	raw ct.	spores/m3	raw ct.	spores/m3
Alternaria										
Arthrinium										
Ascospores*	20	267	4	53	4	53				
Aureobasidium										
Basidiospores*	104	1,390	12	160	20	267	22	293	22	293
Bipolaris/Drechslera group										
Botrytis										
Chaetomium										
Cladosporium	116	1,550	24	320	28	373			22	293
Curvularia										
Epicoccum										
Fusarium										
Myrothecium										
Nigrospora										
Other brown					6	80	1	13		
Other colorless										
Penicillium/Aspergillus types†	16	213	28	373	72	960			44	587
Pithomyces										
Rusts*										
Smuts*, Periconia, Myxomycetes*										
Stachybotrys										
Stemphylium										
Torula										
Ulocladium										
Unknown										
Zygomycetes										
Background debris (1-4+)††	2+		4+		4+		4+		4+	
Hyphal fragments/m3	< 13		13		53		80		13	
Pollen	None		None		None		None		None	
Skin cells	None		1+		1+		1+		1+	
Sample volume (liters)	75		75		75		75		75	
TOTAL SPORES/M3		3,420		906		1,733		306		1,173

Comments:

* Most of these spore types are not seen with culturable methods (Andersen sampling), although some may appear as non-sporulating fungi. Most of the basidiospores are "mushroom" spores while the rusts and smuts are plant pathogens.
 † The spores of *Aspergillus* and *Penicillium* (and others such as *Acremonium*, *Paecilomyces*) are small and round with very few distinguishing characteristics. They cannot be differentiated by non-viable sampling methods. Also, some species with very small spores are easily missed, and may be undercounted.
 †† Background debris indicates the amount of non-biological particulate matter present on the trace (dust in the air) and the resulting visibility for the analyst. It is rated from 1+ (low) to 4+ (high). Counts from areas with 4+ background debris should be regarded as minimal counts and may be actually higher than reported. Background debris also affects the reporting limit for some spore types. The reporting limit is dependent on spore size, background debris, sample volume, and the percentage of the trace analyzed. It is important to account for sample volumes when evaluating dust levels. The minimum reporting limit is based on a raw count of one, which the lowest count that can be detected.
 ‡ A "Version" greater than 1 indicates amended data.

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

MoldRANGE™: Extended Outdoor Comparison
Outdoor Location: 1, Outside control

Fungi Identified	Outdoor data	Typical Outdoor Data by Date†				Typical Outdoor Data by Location‡			
		Month: February				State: WA			
	spores/m3	low	med	high	freq %	low	med	high	freq %
Generally able to grow indoors*									
Alternaria	-	7	20	180	38	6	13	410	17
Bipolaris/Drechslera group	-	7	13	150	10	5	13	380	4
Chaetomium	-	7	13	110	8	7	13	67	5
Cladosporium	1,550	27	320	3,900	91	30	320	5,800	87
Curvularia	-	7	13	420	8	6	13	170	3
Nigrospora	-	7	13	160	7	-	-	-	< 1
Penicillium/Aspergillus types	213	27	170	1,800	85	53	270	3,000	89
Stachybotrys	-	7	13	360	3	5	13	2,000	2
Torula	-	7	13	240	5	7	13	180	6
Seldom found growing indoors**									
Ascospores	267	13	110	2,200	68	28	430	8,200	88
Basidiospores	1,390	13	270	8,900	88	53	1,600	26,000	97
Rusts	-	7	13	220	13	5	13	280	17
Smuts, Periconia, Myxomycetes	-	7	27	280	57	7	27	480	49
TOTAL SPORES/M3	3,420								

† The Typical Outdoor Data by Date represents the typical outdoor spore levels across North America for the month indicated. The last column represents the frequency of occurrence. The low, medium, and high values represent the 2.5, 50, and 97.5 percentile values of the spore type when it is detected. For example, if the frequency of occurrence is 63% and the low value is 53, it would mean that the given spore type is detected 63% of the time and, when detected, 2.5% of the time it is present in levels above the detection limit and below 53 spores/m3. These values are updated periodically, and if enough data is not available to make a statistically meaningful assessment, it is indicated with a dash.

‡ The Typical Outdoor Data by Location represents the typical outdoor spore levels for the region indicated for the entire year. As with the Typical Outdoor Data by Date, the four columns represent the frequency of occurrence and the typical low, medium, and high concentration values for the spore type indicated. These values are updated periodically, and if enough data is not available to make a statistically meaningful assessment, it is indicated with a dash.

*The spores in this category are generally capable of growing on wet building materials in addition to growing outdoors. Building related growth is dependent upon the fungal type, moisture level, type of material, and other factors. *Cladosporium* is one of the predominant spore types worldwide and is frequently present in high numbers. *Penicillium/Aspergillus* species colonize both outdoor and indoor wet surfaces rapidly and are very easily dispersed. Other genera are usually present in lesser numbers.

**These fungi are generally not found growing on wet building materials. For example, the rusts and smuts are obligate plant pathogens. However, in each group there are notable exceptions. For example, agents of wood decay are members of the basidiomycetes and high counts of a single morphological type of basidiospore on an inside sample should be considered significant.

Interpretation of the data contained in this report is left to the client or the persons who conducted the field work. This report is provided for informational and comparative purposes only and should not be relied upon for any other purpose. "Typical outdoor data" are based on the results of the analysis of samples delivered to and analyzed by Environmental Microbiology Laboratory, Inc. and assumptions regarding the origins of those samples. Sampling techniques, contaminants infecting samples, unrepresentative samples and other similar or dissimilar factors may affect these results. In addition, Environmental Microbiology Laboratory, Inc. may not have received and tested a representative number of samples for every region or time period. Environmental Microbiology Laboratory, Inc. hereby disclaims any liability for any and all direct, indirect, punitive, incidental, special or consequential damages arising out of the use or interpretation of the data contained in, or any actions taken or omitted in reliance upon, this report.

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

MoldSTAT™: Supplementary Statistical Spore Trap Report

Outdoor Summary: 1: Outside control

Species detected	Outdoor sample spores/m3				Typical outdoor ranges (North America)	Freq. %
	<100	1K	10K	>100K		
Ascospores				267	13 - 150 - 4,300	76
Basidiospores				1,390	13 - 320 - 13,000	92
Cladosporium				1,550	53 - 530 - 7,800	95
Penicillium/Aspergillus types				213	27 - 210 - 2,600	86
Smuts, Periconia, Myxomycetes				ND	7 - 40 - 760	72
Total				3,420		

The "Typical outdoor ranges" and "Freq. %" columns show the typical low, medium, and high spore counts per cubic meter and the frequency of occurrence for the given spore type. The low, medium, and high values represent the 2.5, 50, and 97.5 percentile values when the spore type is detected. For example, if the low value is 53 and the frequency of occurrence is 63%, it would mean that we typically detect the given spore type on 63 percent of all outdoor samples and, when detected, 2.5% of the time it is present in levels below 53 spores/m3.

Indoor Samples

Location: 2: West Dehu

% of outdoor total spores/m3	Friedman chi-square* (indoor variation)	Agreement ratio** (indoor/outdoor)	Spearman rank correlation*** (indoor/outdoor)	MoldSCORE**** (indoor/outdoor)	
Result: 26%	dF: 3 Result: 4.1400 Critical value: 7.8147 Inside Similar: Yes	Result: 1.0000	dF: 4 Result: -0.2000 Critical value: N/A Outside Similar: N/A	Score: 150 Result: Medium	
Species Detected		Spores/m3			
		<100	1K	10K	>100K
Ascospores					53
Basidiospores					160
Cladosporium					320
Penicillium/Aspergillus types					373
Total					906

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

MoldSTAT™: Supplementary Statistical Spore Trap Report

Location: 3: South bed

% of outdoor total spores/m3	Friedman chi-square* (indoor variation)	Agreement ratio** (indoor/outdoor)	Spearman rank correlation*** (indoor/outdoor)	MoldSCORE**** (indoor/outdoor)	
Result: 50%	dF: 3 Result: 4.1400 Critical value: 7.8147 Inside Similar: Yes	Result: 0.8889	dF: 5 Result: 0.2000 Critical value: 0.8000 Outside Similar: No	Score: 221 Result: Medium	
Species Detected		Spores/m3			
		<100	1K	10K	>100K
Ascospores					53
Basidiospores					267
Cladosporium					373
Other brown					80
Penicillium/Aspergillus types					960
Total					1,733

Location: 4: South entry





% of outdoor total spores/m3	Friedman chi-square* (indoor variation)	Agreement ratio** (indoor/outdoor)	Spearman rank correlation*** (indoor/outdoor)	MoldSCORE**** (indoor/outdoor)	
Result: 8%	dF: 3 Result: 4.1400 Critical value: 7.8147 Inside Similar: Yes	Result: 0.3333	dF: 5 Result: 0.0000 Critical value: 0.8000 Outside Similar: No	Score: 118 Result: Low	
Species Detected		Spores/m3			
		<100	1K	10K	>100K
Basidiospores					293
Other brown					13
Total					306

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

MoldSTAT™: Supplementary Statistical Spore Trap Report

Location: 5: North

% of outdoor total spores/m3	Friedman chi-square* (indoor variation)	Agreement ratio** (indoor/outdoor)	Spearman rank correlation*** (indoor/outdoor)	MoldSCORE**** (indoor/outdoor)	
Result: 34%	dF: 3 Result: 4.1400 Critical value: 7.8147 Inside Similar: Yes	Result: 0.8571	dF: 4 Result: -0.2500 Critical value: N/A Outside Similar: N/A	Score: 179 Result: Medium	
Species Detected		Spores/m3			
		<100	1K	10K	>100K
Basidiospores					
Cladosporium					
Penicillium/Aspergillus types					
Total					

* The Friedman chi-square statistic is a non-parametric test that examines variation in a set of data (in this case, all indoor spore counts). The null hypothesis (H0) being tested is that there is no meaningful difference in the data for all indoor locations. The alternative hypothesis (used if the test disproves the null hypothesis) is that there is a difference between the indoor locations. The null hypothesis is rejected when the result of the test is greater than the critical value. The critical value that is displayed is based on the degrees of freedom (dF) of the test and a significance level of 0.05.

** An agreement ratio is a simple method for assessing the similarity of two samples (in this case the indoor sample and the outdoor summary) based on the spore types present. A score of one indicates that the types detected in one location are the same as that in the other. A score of zero indicates that none of the types detected indoors are present outdoors. Typically, an agreement of 0.8 or higher is considered high.

*** The Spearman rank correlation is a non-parametric test that examines correlation between two sets of data (in this case the indoor location and the outdoor summary). The null hypothesis (H0) being tested is that the indoor and outdoor samples are unrelated. The alternative hypothesis (used if the test disproves the null hypothesis) is that the samples are similar. The null hypothesis is rejected when the result of the test is greater than the critical value. The critical value that is displayed is based on the degrees of freedom (dF) of the test and a significance level of 0.05.

**** MoldSCORE™ is a specialized method for examining air sampling data. It is a score between 100 and 300, with 100 indicating a greater likelihood that the airborne indoor spores originated from the outside, and 300 indicating a greater likelihood that they originated from an inside source. The Result displayed is based on the numeric score given and will be either Low, Medium, or High, indicating a low, medium, or high likelihood that the spores detected originated from an indoor source. EMLab reserves the right to, and may at anytime, modify or change the MoldScore algorithm without notice.

Interpretation of the data contained in this report is left to the client or the persons who conducted the field work. This report is provided for informational and comparative purposes only and should not be relied upon for any other purpose. "Typical outdoor ranges" are based on the results of the analysis of samples delivered to and analyzed by Environmental Microbiology Laboratory, Inc. and assumptions regarding the origins of those samples. Sampling techniques, contaminants infecting samples, unrepresentative samples and other similar or dissimilar factors may affect these results. With the statistical analysis provided, as with all statistical comparisons and analyses, false-positive and false-negative results can and do occur. Environmental Microbiology Laboratory, Inc. hereby disclaims any liability for any and all direct, indirect, punitive, incidental, special or consequential damages arising out of the data contained in, or any actions taken or omitted in reliance upon, this report.

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

MoldSCORE™: Spore Trap Report

Location: 3 South bed

Fungi Identified	Indoor sample spores/m3				Raw count	Spores/m3	MoldSCORE‡			
	<100	1K	10K	>100K			100	200	300	Score
Generally able to grow indoors*										
Alternaria					ND	< 13	█			100
Bipolaris/Drechslera group					ND	< 13	█			100
Chaetomium					ND	< 13	█			100
Cladosporium	█	█			28	373	█			100
Curvularia					ND	< 13	█			100
Nigrospora					ND	< 13	█			100
Other brown	█				6	80	█	█		132
Penicillium/Aspergillus types†	█	█	█		72	960	█	█	█	221
Stachybotrys					ND	< 13	█			100
Torula					ND	< 13	█			100
Seldom found growing indoors**										
Ascospores††	█				4	53	█			100
Basidiospores††	█	█			20	267	█			100
Rusts					ND	< 13	█			100
Smuts, Periconia, Myxomycetes††					ND	< 13	█			100
Total						1,733				Final MoldSCORE 221

Location: 4 South entry

Fungi Identified	Indoor sample spores/m3				Raw count	Spores/m3	MoldSCORE‡			
	<100	1K	10K	>100K			100	200	300	Score
Generally able to grow indoors*										
Alternaria					ND	< 13	█			100
Bipolaris/Drechslera group					ND	< 13	█			100
Chaetomium					ND	< 13	█			100
Cladosporium					ND	< 13	█			100
Curvularia					ND	< 13	█			100
Nigrospora					ND	< 13	█			100
Other brown	█				1	13	█			105
Penicillium/Aspergillus types†					ND	< 13	█			100
Stachybotrys					ND	< 13	█			100
Torula					ND	< 13	█			100
Seldom found growing indoors**										
Ascospores††					ND	< 13	█			100
Basidiospores††	█	█			22	293	█			118
Rusts					ND	< 13	█			100
Smuts, Periconia, Myxomycetes††					ND	< 13	█			100
Total						306				Final MoldSCORE 118

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

MoldSCORE™: Spore Trap Report

Location: 5 North

Fungi Identified	Indoor sample spores/m ³				Raw count	Spores/m ³	MoldSCORE‡			
	<100	1K	10K	>100K			100	200	300	Score
Generally able to grow indoors*										
Alternaria					ND	< 13	100			
Bipolaris/Drechslera group					ND	< 13	100			
Chaetomium					ND	< 13	100			
Cladosporium	█				22	293	100			
Curvularia					ND	< 13	100			
Nigrospora					ND	< 13	100			
Penicillium/Aspergillus types†	█	█			44	587	179			
Stachybotrys					ND	< 13	100			
Torula					ND	< 13	100			
Seldom found growing indoors**										
Ascospores††					ND	< 13	100			
Basidiospores††	█				22	293	100			
Rusts					ND	< 13	100			
Smuts, Periconia, Myxomycetes††					ND	< 13	100			
Total						1,173	Final MoldSCORE 179			

*The spores in this category are generally capable of growing on wet building materials in addition to growing outdoors. Building related growth is dependent upon the fungal type, moisture level, type of material, and other factors. *Cladosporium* is one of the predominant spore types worldwide and is frequently present in high numbers. *Penicillium/Aspergillus* species colonize both outdoor and indoor wet surfaces rapidly and are very easily dispersed. Other genera are usually present in lesser numbers.

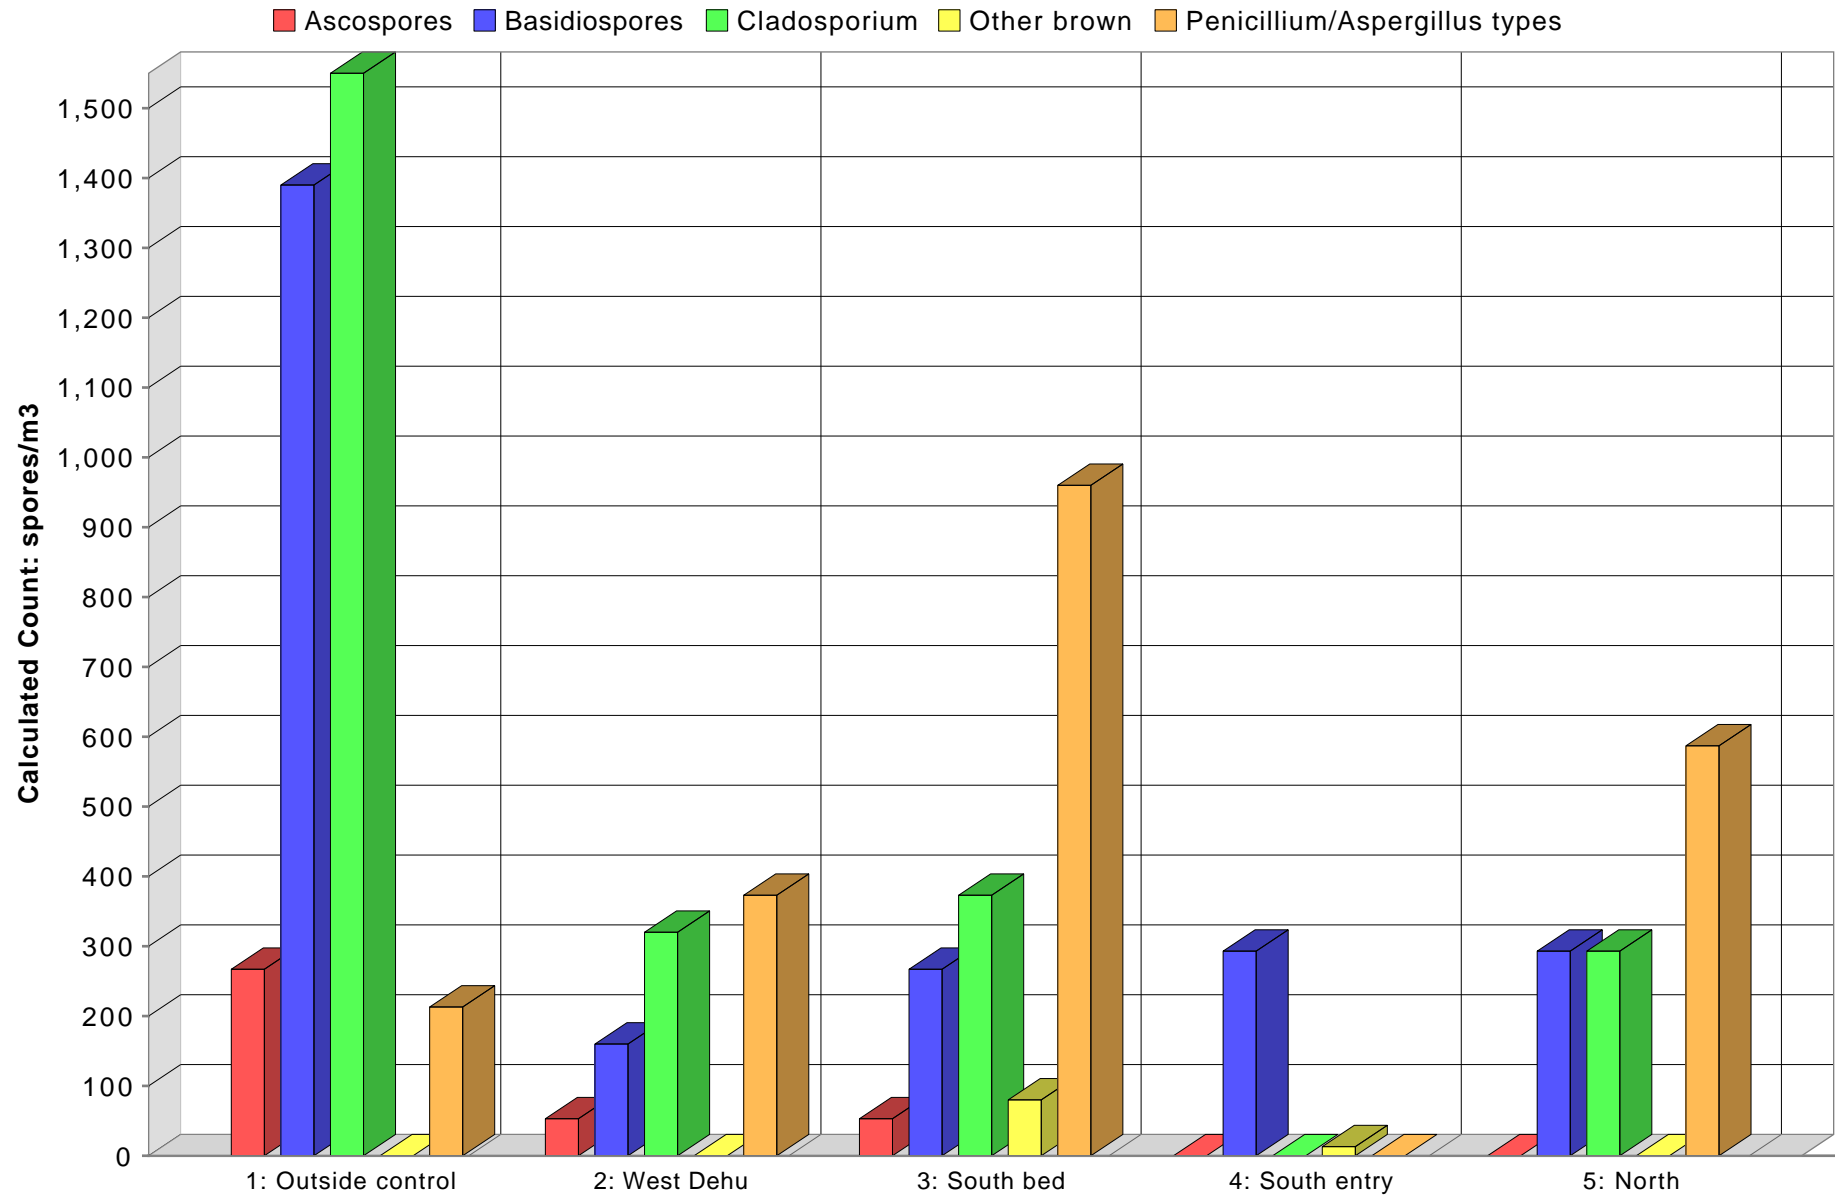
**These fungi are generally not found growing on wet building materials. For example, the rusts and smuts are obligate plant pathogens. However, in each group there are notable exceptions. For example, agents of wood decay are members of the basidiomycetes and high counts of a single morphological type of basidiospore on an inside sample should be considered significant.

†The spores of *Aspergillus* and *Penicillium* (and others such as *Acremonium*, *Paecilomyces*) are small and round with very few distinguishing characteristics. They cannot be differentiated by non-viable sampling methods.

††Most of these spore types are not seen with culturable methods (Anderson sampling), although some may appear as non-sporulating fungi. Most of the basidiospores are "mushroom" spores.

‡Rated on a scale from 100 to 300. A rating less than 150 is low and indicates a low probability of spores originating inside. A rating greater than 250 is high and indicates a high probability that the spores originated from inside, presumably from indoor mold growth. A rating between 150 and 250 indicates a moderate likelihood of indoor fungal growth. MoldSCORE is NOT intended for wall cavity samples. It is intended for ambient air samples in residences. Using the analysis on other samples (like wall cavity samples) will lead to misleading results.

SPORE TRAP REPORT: NON-VIABLE METHODOLOGY



Comments:

Note: Graphical output may understate the importance of certain "marker" genera.

Client: ENVIRONIX
 C/O: Mr. Steve Wallstrom
 Re: Sample report

Date of Sampling: 02-07-2007
 Date of Receipt: 02-08-2007
 Date of Report: 02-09-2007

OTHER BIOLOGICAL PARTICLES REPORT: NON-VIABLE METHODOLOGY

Location:	1: Outside control		2: West Dehu		3: South bed		4: South entry		5: North	
Comments (see below)	None		None		None		None		None	
Lab ID-Version‡:	1234567-1		1234567-1		1234567-1		1234567-1		1234567-1	
	raw ct.	particles/m ³	raw ct.	particles/m ³	raw ct.	particles/m ³	raw ct.	particles/m ³	raw ct.	particles/m ³
POLLEN										
Alder (Alnus)										
Ash (Fraxinus)										
Birch (Betula)										
Cedar/Juniper (Cupressaceae)										
Chenopods (Chenopodiaceae)										
Elm (Ulmus)										
Eucalyptus (Eucalyptus)										
Grass (Poaceae)										
Mulberry (Morus)										
Oak (Quercus)										
Other										
Pine (Pinaceae)										
Ragweed (Ambrosieae)										
Sycamore (Platanus)										
OTHER PLANT										
Algae										
Diatoms										
Fern, moss, etc. spores										
Other (wood, trichomes, etc.)	3	40	16	213	20	267	12	160	21	280
OTHER PARTICLES:										
ANIMAL										
Epithelial (skin) cells			92	1,230	36	480	52	693	36	480
Hair										
Insect parts										
Mites										
FUNGI										
Hyphal fragments			1	13	4	53	6	80	1	13
NON-BIOLOGICAL										
Glass fiber	2	27	25	333	7	93	4	53	22	293
Soot-like	11	147	13	173	5	67	40	533	7	93
Starch particles							180	2,400		
Background debris (1-4+)†	2+		4+		4+		4+		4+	
Sample volume (liters)	75		75		75		75		75	

Comments:

Note: Interpretation is left to the company and/or persons who conducted the field work.

† Background debris is an indication of the amounts of non-biological particulate matter present on the slide (dust in the air) and is graded from 1+ to 4+ with 4+ indicating the largest amounts. To evaluate dust levels it is important to account for differences in sample volume.

‡ A "Version" greater than 1 indicates amended data.